



ENVIRONMENTAL
HEALTH
PERSPECTIVES

<http://www.ehponline.org>

Water Distribution System Deficiencies and
Gastrointestinal Illness:
A Systematic Review and Meta-Analysis

Ayse Ercumen, Joshua S. Gruber, and John M. Colford Jr.

<http://dx.doi.org/10.1289/ehp.1306912>

Received: 8 April 2013

Accepted: 20 March 2014

Advance Publication: 21 March 2014

Water Distribution System Deficiencies and Gastrointestinal Illness: A Systematic Review and Meta-Analysis

Ayse Ercumen, Joshua S. Gruber, and John M. Colford Jr.

Division of Epidemiology, School of Public Health, University of California, Berkeley,
Berkeley, California, USA

Address correspondence to Ayse Ercumen, 50 University Hall, #7360, Berkeley, CA 94720-7360 USA. Telephone: (510) 225 8828. E-mail: aercumen@berkeley.edu

Running Title: Water Distribution Systems and Gastrointestinal Illness

Acknowledgments: None

Competing Financial Interests: None to declare.

Abstract

Background: Water distribution systems are vulnerable to performance deficiencies that can cause (re)contamination of treated water and plausibly lead to increased risk of gastrointestinal illness (GII) in consumers.

Objectives: It is well established that large system disruptions in piped water networks can cause GII outbreaks. We hypothesized that routine network problems can also contribute to background levels of waterborne illness and conducted a systematic review and meta-analysis to assess the impact of distribution system deficiencies on endemic GII.

Methods: We reviewed published studies that compare direct tap water consumption to consumption of tap water re-treated at the point of use (POU) and studies of specific system deficiencies such as breach of physical or hydraulic pipe integrity and lack of disinfectant residual.

Results: In settings with network malfunction, consumers of tap versus POU-treated water had increased GII (incidence density ratio (IDR) = 1.34; 95% CI: 1.00, 1.79). The subset of non-blinded studies showed a significant association between GII and tap versus POU-treated water consumption (IDR = 1.52; 95% CI: 1.05, 2.20), but there was no association based on studies that blinded participants to their POU water treatment status (IDR = 0.98; 95% CI: 0.90, 1.08). Among studies focusing on specific network deficiencies, GII was associated with temporary water outages (relative risk = 3.26; 95% CI: 1.48, 7.19) as well as chronic outages in intermittently operated distribution systems (odds ratio = 1.61; 95% CI: 1.26, 2.07).

Conclusions: Tap water consumption is associated with GII in malfunctioning distribution networks. System deficiencies such as water outages also are associated with increased GII, suggesting a potential health risk for consumers served by piped water networks.

Introduction

Diarrheal diseases are responsible for a large health burden worldwide, causing approximately 10% of deaths among children < 5 years (Lozano 2012). Diarrhea is also common in developed countries (Herikstad et al. 2002; Roy et al. 2006) and can have large economic implications in terms of medical expenditures and loss of workdays (Payment and Hunter 2001). One of the risk factors leading to this global disease burden is unsafe drinking water, both in developing and developed country settings (Black et al. 2003; Colford et al. 2006; Messner et al. 2006; Reynolds et al. 2008).

The focus of this review is drinking water-related diarrheal disease risk in settings where water is centrally distributed via a piped network. In such settings, diarrheal disease due to drinking water can be caused by contamination at the source, at the treatment plant (if any), in the distribution system, or at user end-points (Craun et al. 2010). Here, we focus on (re)contamination of water in the distribution network before it reaches consumer taps, which can put consumers at risk of diarrheal illness even when the treatment plant effluent is in compliance with all drinking water quality regulations. Such contamination events are caused by deficiencies in the distribution system, including breach of physical pipe integrity (i.e., pipes can no longer provide adequate physical barrier against external contamination due to factors such as cross-connections with non-potable lines, fractures, leaky joints, corrosion associated with aging), breach of hydraulic pipe integrity (i.e., pipes can no longer provide a reliable water supply in terms of volume or pressure due to factors such as main breaks, pump outages or sudden changes in demand) and breach of water quality integrity (i.e., water quality deteriorates in pipes through factors such as decay of disinfectant residual) (NRC 2006). Both physical and hydraulic breaches are necessary for contamination to occur; lack of water pressure during hydraulic breaches allows external

contamination to enter pipelines through the portals created by physical breaches. Entry of pathogens can be in the form of backflow from cross-connections or intrusion through leaks and cracks (Besner et al. 2011; LeChevallier et al. 2003). Aging water infrastructure in the U.S. and other developed countries makes water distribution systems particularly vulnerable to pathogen intrusion through increasingly frequent pipe breaks and other types of aging-related deterioration as pipelines approach the end of their service lives (USEPA 2011), and breaks, cracks and leaks in pipelines are also very common in the inadequately maintained and often overburdened water distribution systems of developing countries (Lee and Schwab 2005). The WHO recommends maintaining a chlorine residual of 0.2 to 0.5 mg/L in the distribution network to provide protection against pathogen intrusion in the event of breaches of physical and/or hydraulic pipe integrity (WHO 2011). However, not all networks maintain the recommended level of residual, and even in adequately chlorinated networks it is debated whether the disinfectant residual can effectively inactivate intruding pathogens and preserve the water quality integrity (Gadgil 1998; Payment 1999).

Links between waterborne disease outbreaks and distribution system deficiencies have been well documented in the U.S. and in developing countries (Craun and Calderon 2001; Craun et al. 2010; Lee and Schwab 2005). In contrast, the contribution of distribution systems to waterborne illness under non-outbreak conditions is not well understood. Risk assessment models have suggested distribution system problems as a potential risk factor for sporadic gastrointestinal illness (GII) (Lambertini et al. 2012; McInnis 2004; Teunis et al. 2010). Such models, however, typically rely on several assumptions. Findings from epidemiologic studies on the association between distribution systems and endemic GII have been mixed and, while previous reviews of limited scope on the subject exist (Colford et al. 2006; NRC 2006), the body of epidemiologic

evidence on endemic levels of GII due to distribution system deficiencies, to our knowledge, has not been systematically reviewed previously.

We conducted a systematic review and meta-analysis to investigate whether distribution system deficiencies are associated with increased risk of endemic waterborne illness in consumers of tap water. Our first research question was whether consumption of centrally treated and distributed tap water increases the risk of GII compared to consumption of tap water re-treated at the point of use (POU). By focusing on water that has been treated at a centralized facility and is safe to drink as it exits the treatment plant, we aimed to isolate the role of the distribution network from other potential causes of contamination at the source or treatment plant. Our second research question was whether reported distribution system problems such as breach of physical, hydraulic or water quality integrity in pipelines is associated with increases in the risk of GII in tap water consumers served by piped networks.

Methods

Literature search

We searched the Cochrane Library, Medline, EMBASE and Web of Science for relevant published articles using combinations of the keywords “tap water, drinking water, distribution system(s), public water supply, municipal water supply” with “diarrh(o)ea, diarrh(o)eal, gastrointestinal, gastroenteritis, gastritis.” The titles and abstracts of articles were screened for eligibility, and full texts of relevant articles were reviewed. The bibliographies of eligible articles were screened to identify additional studies.

Selection criteria

The primary inclusion criterion was that the measured exposure was consumption of tap water, as obtained from the tap without further treatment. For studies comparing direct consumption of tap water to consumption of tap water re-treated at the POU, an additional criterion was that study participants received their tap water from centralized water treatment systems that did not report treatment failures at the time of the study and/or were reported to be in compliance with microbial water quality regulations. The second inclusion criterion was that the reported outcome was endemic GII, under non-outbreak conditions as reported by the authors. Multiple GII definitions were accepted including diarrhea, gastroenteritis, acute gastrointestinal illness (AGI, defined as a combination of diarrhea and vomiting), highly credible gastrointestinal illness (HCGI, defined as different combinations of diarrhea, vomiting, nausea and abdominal pain), highly credible gastroenteritis (HCG, defined similarly to HCGI) and infections with specific diarrheagenic pathogens (e.g., *Campylobacter*); however, infections with protozoan pathogens such as *Cryptosporidium* and *Giardia* were excluded as these organisms can be resistant to water treatment (Steiner et al. 1997), making it difficult to isolate contamination occurring in the distribution system from treatment failure at the plant. The third inclusion criterion was the use of epidemiological methods to link exposures to health outcomes; studies using a risk assessment approach to infer GII outcomes from water quality data were excluded as these use theoretical transmission models that rely on several assumptions (Soller 2006) to estimate disease risk in contrast to epidemiological methods that measure disease outcomes directly. Finally, because the objective of our review is to characterize the risk of endemic GII among general populations that are exposed to distribution system deficiencies, we excluded studies on specific sub-populations that are particularly vulnerable to GII from waterborne pathogens, such as the elderly and

immuno-compromised (Colford Jr et al. 2005, 2009; Gerba et al. 1996) or individuals that are not representative of a resident population, such as travelers (Ericsson 1998). The review was limited to studies in English, German or Spanish (the languages spoken by the authors), with no limitations on study location or quality.

Data extraction and meta-analysis

Data were extracted independently by two unblinded authors (AE and JSG), and discrepancies were resolved by discussion. Estimates of relative risk (RR), such as incidence density ratios (IDR) and odds ratios (OR) along with 95% confidence intervals were extracted from the selected studies when available, and otherwise calculated from the reported data using standard methods (Rothman et al. 2008). All relative measures were expressed such that a value larger than 1.0 indicates increased risk in the exposed group. If a study reported both unadjusted and adjusted estimates controlling for covariates, the adjusted estimates were used. If effect estimates for multiple age groups were reported, the estimates for all ages combined were extracted.

To address our research questions, the studies were grouped as follows: (1) studies comparing consumption of tap water obtained directly from the tap to consumption of tap water re-treated at the POU, and (2) studies assessing the risk of GII associated with specific distribution system deficiencies. The second group was further sub-classified as per previously defined categories of distribution system problems (NRC 2006) into studies that focus on: (1) breach of physical pipe integrity such as cross-connections, cracks and aging-related pipe deterioration, (2) breach of hydraulic pipe integrity such as pressure loss in the network, and (3) breach of water quality integrity such as lack of adequate disinfection residual. We conducted a separate meta-analysis for each subgroup of studies (Figure 1) as we anticipated different types of distribution system deficiencies to have different health impacts as well as different policy implications.

The meta-analysis was conducted using STATA (version 12, STATA Corp., College Station, TX). Fixed and random effects models with inverse variance weighting were used to pool the risk estimates, when appropriate. Heterogeneity was assessed using the Mantel-Haenszel χ^2 statistic, and random effects models were used when heterogeneity was detected, defined as a p-value less than 0.20 on the χ^2 statistic. Otherwise, fixed effects models were used. Several factors were specified *a priori* as potential sources of heterogeneity, including location (developed vs. developing country as per the International Monetary Fund’s definition of “advanced economies vs. “emerging and developing economies” (IMF 2013)), characteristics of the study design (randomized vs. observational, blinded vs. non-blinded) and distribution system performance during study period (continuously vs. intermittently operated, malfunctioning vs. non-malfunctioning (Figure 1)). For the purposes of our analysis, a malfunctioning system was defined *a priori* as one that had reported breaches of physical integrity (e.g., pipe breaks), breaches of hydraulic integrity (e.g., service intermittencies, low or negative pressure events) or breaches of water quality integrity (e.g., inadequate disinfectant residual in the network despite chlorination prior to distribution system entry). Subgroup analyses were performed to explore the impact of these factors on summary estimates. Sensitivity analyses were conducted to determine if pooled estimates were disproportionately affected by any one study. Publication bias was assessed using the Begg’s test, with a p-value less than 0.20 interpreted as evidence for bias (Egger et al. 2001).

Results

The titles and/or abstracts of 6,245 studies were screened and the full texts of 62 articles were reviewed (Figure 2). The literature that we excluded based on title/abstract review included studies on waterborne disease outbreaks (including outbreaks caused by protozoan pathogens)

and studies conducted in rural populations without access to centralized water supply. Of the 62 articles we reviewed in full text, 20 studies were identified for inclusion in the systematic review and 14 of these with combinable data were included in the meta-analysis. Ineligible studies reviewed in full text were excluded because they were reviews or general articles with no health outcomes (n=18), contamination occurred prior to distribution system entry (at the water source or treatment plant) or there was not sufficient information to differentiate contamination in the distribution system from contamination at the source or plant (n=17), exposure was either not tap water or a mix of tap water and other sources (n=6) or study authors did not report data on the association between the tap water exposures and GII outcomes (n=1).

Studies of tap water vs. POU-treated water

Six studies investigated the effects of consuming tap water versus POU-treated tap water (Table 1) (Colford Jr et al. 2002, 2005; Hellard et al. 2001; Payment et al. 1991, 1997; Semenza et al. 1998).

Study characteristics

Five of the studies were cluster-randomized trials (CRT), and one study was an observational analysis within a CRT (Table 1). In all studies, the exposed group consumed tap water directly from the tap without further treatment. In five studies, control group tap water was re-treated at the POU; one study provided households with bottles of treated plant water re-filtered by reverse osmosis or bottles of spring water, both of which were ozonated prior to bottling. Three studies achieved blinding by employing water treatment devices in the POU-treatment group that did not alter the taste of water and providing households in the tap water group with a sham device that

looked identical to the active water treatment device. The remaining three studies were non-blinded. All six studies ascertained GII status through self-report.

Water system characteristics

Five of the studies were conducted in developed countries and one in a developing country (Table 1). The water system characteristics varied between the studies. The source water ranged from well-protected forest catchments to rivers heavily contaminated with sewage and run-off. Five studies provided source water quality data, and all five reported that pathogens or fecal indicator organisms were detected in the source water. The water treatment plants employed conventional treatment with chlorination or chloramination in four studies, and only chlorination in two studies. Four studies reported the finished plant effluent to be in compliance with microbial water quality regulations, and none of the studies reported treatment plant failures during the study period. Four studies had a malfunctioning distribution system as reported by study authors and by independent investigators (Besner et al. 2010; LeChevallier et al. 2002), while one study was conducted in a system with no evidence of malfunctioning and one study did not provide information on distribution system operation.

Summary of study findings

Four of the studies reported positive associations between GII and tap vs. POU-treated water consumption, though associations reported by two of the studies were not statistically significant. The remaining two studies found no associations (Table 1). The Begg's test suggested evidence of publication bias ($p = 0.06$). Significant heterogeneity was observed across the six studies ($p < 0.0005$); an overall pooled estimate was therefore not calculated.

Sources of heterogeneity were explored by performing subgroup analyses with respect to study location (developed vs. developing country), study type (CRT vs. observational), blinding status (blinded vs. non-blinded) and distribution system performance during the study period (malfunctioning vs. non-malfunctioning based on reported data on network hydraulics and chlorine residual) (Table 2). The association reported by the one observational study conducted in a developing country (IDR = 2.61; 95% CI: 1.71, 4.00) was stronger than the random effects pooled IDR based on the five randomized controlled trials in developed countries (IDR = 1.09; 95% CI: 0.95, 1.25). Non-blinded studies where participants in the intervention group were aware that they were consuming POU-treated water showed a significant increase in GII associated with direct tap water consumption (random effects pooled IDR = 1.52; 95% CI: 1.05, 2.20); significant heterogeneity remained among these studies ($p = 0.003$). In contrast, there was no association based on the three blinded studies (fixed effects pooled IDR = 0.98; 95% CI: 0.90, 1.08, heterogeneity p -value = 0.5). In the subset of studies with a malfunctioning distribution system, tap water was associated with a 34% increase in the rate of GII relative to the rate among treated water consumers (random effects pooled IDR = 1.34; 95% CI: 1.00, 1.79) (Figure 3) but significant heterogeneity remained ($p < 0.0005$). The association decreased when we excluded the developing country study (Semenza et al. 1998) that had more severe distribution system deficiencies, with approximately half of users reporting discernible pressure loss as opposed to transient low pressures detected by loggers in the other studies (random effects pooled IDR = 1.14; 95% CI: 0.95, 1.37, heterogeneity p -value = 0.06). Two of the studies in malfunctioning systems showed increasing risk of GII with increasing water consumption in the tap water group but not in the treated water group, by classifying the volume of water intake as a three-level categorical variable and conducting a trend test for the incidence of GII (Payment et al. 1991,

1997). The study that did not provide information on distribution system operation (Colford et al. 2002) reported a non-significant positive association between GII and tap vs. POU-treated water consumption, and the study conducted in a properly operating system (Colford et al. 2005) did not show an association.

Studies on loss of physical pipe integrity

Six studies focused on loss of physical pipe integrity (Table 3) (Abu Amr and Yassin 2008; D'Argenio et al. 1995; Mohanty et al. 2002; Nygard et al. 2004; Tinker et al. 2009; Yassin et al. 2006).

Study characteristics

One study assessed the impact of cross-connections with sewer lines, one used pipe material as a proxy for physical integrity, two focused on pipe age as a proxy for aging-related deterioration and two focused on pipe length and hydraulic residence time as an aggregate measure (longer pipelines are more likely to have a larger number of leaks and fractures and there are more opportunities for intrusion of pathogens through these when the water spends more time in pipes) (Table 3). Data on pipe characteristics were obtained from water utilities or reported by participants. With the exception of one study, where there was media awareness about fecal contamination in the network caused by the cross-connections (D'Argenio et al. 1995), participants were effectively blind to their exposure status as knowledge of the physical state of water pipes as a risk factor for GII was presumably limited in study populations. GII outcomes were assessed by surveillance records or from self-reported symptoms.

Water system characteristics

Three of the studies were conducted in developed countries and three in developing countries (Table 3). The developed country studies presumably had continuously operated distribution systems while in all three developing country studies distribution system operation was reported to be intermittent, with water delivered for a limited number of hours per day. One study did not provide quantifiable data on disinfectant residual in the network; the rest were conducted in chlorinated systems with varying levels of residual.

Summary of study findings

The studies showed a range of positive associations between GII and the different exposures related to loss of physical pipe integrity, though some of the effect estimates were close to the null and three of the studies reported associations that were not statistically significant (Table 3). Due to the differences in the exposure definitions among the studies, a meta-analysis on health outcomes was not conducted; instead we summarize the general findings of the individual studies. Residing on a street served by a pipeline with fecal contamination due to presence of cross-connections between water and sewer lines was associated with the occurrence of self-reported GII symptoms in tap water consumers compared to residing on a socioeconomically similar nearby street served by an uncontaminated pipeline (D'Argenio et al. 1995). Unit increase in percent of cast-iron water pipes, as opposed to more leak-prone materials, in a given service area appeared protective against self-reported GII outcomes aggregated at the service area level (Mohanty et al. 2002). In two studies, increased illness was observed in consumers served by networks >1 year old (compared to networks \leq 1 year old), but the effect estimate was very close to the null in one of these studies and both studies had low precision (Abu Amr and Yassin 2008; Yassin et al. 2006). Two studies reported positive associations of GII with

increasing water residence time in the distribution system. One reported that the incidence of *Campylobacter* infections increased with every 10-meter increase in water pipe length per person in a given service area (defined as the total length of the distribution network in the municipality divided by the number of people served) (Nygard et al. 2004). The other study investigated the association between GII and hydraulic residence time (i.e., time it takes for water to travel from the treatment plant to consumer taps), which was calculated from the water utilities' hydraulic models, aggregated by zip code and defined as a categorical variable with three levels (short, intermediate, long) based on the 10th and 90th percentiles. The authors reported that people living in zip codes with long water residence time were slightly more likely to have medical visits related to GII in comparison to zip codes with intermediate water residence time, while there was no difference in GII between people from zip codes with intermediate vs. short residence times (Tinker et al. 2009). Additionally, two of the previously discussed CRTs (Payment et al. 1991, 1997) had mixed findings on the impact of distance from the treatment plant on GII. Secondary analysis of the data from the 1991 study showed that increasing distance from the treatment plant (classified as a five-level categorical variable) showed increasing IDR for GII for tap vs. POU-treated water consumption (Payment et al. 1993) while no association with hydraulic residence time was found in the 1997 study (method of analysis not specified by authors).

Studies on loss of hydraulic pipe integrity

Nine studies investigated the effects of loss of hydraulic pipe integrity (Table 4) (Abu Amr and Yassin 2008; Abu Mourad 2004; Cifuentes et al. 2002; Fewtrell et al. 1997; Huang et al. 2011; Hunter et al. 2005; Nygard et al. 2007; Özkan et al. 2007; Yassin et al. 2006).

Study characteristics

The exposure in five studies was temporary pressure loss at the tap (i.e., water outage) typically caused by main breaks or repair work in otherwise continuously operated distribution networks (compared to no water outages), and in four studies the exposure was chronic outages associated with intermittent water delivery (compared to uninterrupted full-day delivery) or the duration of such chronic outages (>1 day vs. 1-day long) (Table 4). The studies obtained water outage data from water utilities or through self-report by participants. By the nature of the exposure, participants were non-blinded to their exposure status as loss of pressure at the tap was evident to study participants; however, knowledge of pressure loss as a risk factor for GII was presumably limited. GII symptoms were ascertained from surveillance or hospital data or from self-reported symptoms.

Water system characteristics

Of the five studies in continuous distribution systems, all but one were conducted in developed countries while the four studies of intermittent systems were all conducted in developing countries. None of the studies of continuous systems provided additional information on water system characteristics, with the exception of one study reporting that the water utility was compliant with drinking water regulations (Table 4). Among the studies of intermittent systems, one did not specify whether the source water was chlorinated before distribution. The other three were conducted in chlorinated networks and, of these, only two reported the level of residual.

Summary of study findings

All nine studies suggested increased risk of GII associated with water outages, both in continuously and intermittently operated systems (Table 4). Because of inherent operational

differences between intermittent and continuous distribution networks, studies in these categories were analyzed separately. Among the five studies in continuous systems, one study was excluded from the pooled analysis because it only reported a correlation coefficient (but did not find evidence for a causative temporal link). For the remaining four studies, the Begg's test suggested evidence of publication bias ($p = 0.04$). The pooled analysis showed a significant increase in GII associated with water outages as compared to normal operation without outages (random effects pooled RR = 3.26; 95% CI: 1.48, 7.19) (Figure 4) with significant heterogeneity among studies ($p < 0.0005$). Limiting the analysis to studies in developed countries (i.e., excluding Ozkan et al. 2007) somewhat reduced the pooled estimate (random effects pooled RR = 2.34; 95% CI: 1.13, 4.86) but did not eliminate the heterogeneity ($p < 0.0005$). One of the studies reported increased GII when the outages lasted longer vs. shorter than six hours (OR = 1.90; 95% CI: 1.00, 3.40) within the group that had outages, as well as increased GII with increasing water consumption (>1 vs. ≤ 1 glass per person per day) in the study group that experienced outages but not in the unexposed group (Nygard et al. 2007).

For studies in intermittently operated systems, publication bias could not be assessed due to the small number of studies in each exposure category. The pooled analysis of the two studies on chronic intermittencies in water delivery showed increased odds of GII (fixed effects pooled OR = 1.61; 95% CI: 1.26, 2.07; heterogeneity p -value = 0.4) compared to full-day water supply. The pooled analysis of the two studies on the duration of intermittencies showed a significant increase in GII with intermittencies lasting longer than a day (fixed effects pooled RR = 1.42; 95% CI: 1.11, 1.82; heterogeneity p -value = 0.7) compared to intermittencies lasting one day.

Studies on loss of water quality integrity

Three studies assessed the effects of low or non-detectable residual in the distribution system despite centralized chlorination prior to distribution (Table 5). (Egorov et al. 2002; Mohanty et al. 2002; Semenza et al. 1998).

Study characteristics

The exposure definitions varied between the studies (Table 5). One study focused on lack of detectable chlorine residual at the tap compared to detectable residual. One study estimated the effect of interquartile (0.22 mg/L) decrease in free chlorine residual in the network (relative to the residual in the plant effluent). One study focused on the effect of a unit increase in the percentage of distribution system samples without detectable residual within a given service area. Exposure was assessed by measurement of chlorine residual by the utility or study investigators, and GII outcomes were ascertained through self-report in all studies.

Water system characteristics

Two studies were conducted in previously described distribution systems with intermittencies in delivery (Mohanty et al. 2002; Semenza et al. 1998) (Tables 1 and 3) and one was conducted in a system serving conventionally treated and chlorinated groundwater via a network with variable water pressure in different parts but no reported pressure loss events (Egorov et al. 2002).

Summary of study findings

All three studies suggested an association between GII and lack or decrease of chlorine residual but only one study had a statistically significant effect estimate (Table 5). One of the studies noted a correlation between decreasing chlorine residual and increasing distance from the plant, suggesting residence time in the network as a potential causal factor behind the association

between the decrease in chlorine residual and increase in GII (Egorov et al. 2002). Due to the differences in study designs and exposure definitions among the studies, a meta-analysis was not performed.

Discussion

Our review of studies that compare tap to POU-treated water consumption suggests that directly consuming tap water is associated with GII outcomes in settings where distribution systems are documented to have deficiencies such as low-pressure events or inadequate disinfectant residual (IDR = 1.34; 95% CI: 1.00, 1.79) (Table 2). No significant association was observed in the only study done in a properly functioning distribution system. A pooled estimate based on the subset of three non-blinded studies indicated a significant positive association between GII and tap versus POU-treated water consumption (IDR = 1.52; 95% CI: 1.05, 2.20); however, there was no association based on the three blinded studies (IDR = 0.98; 95% CI: 0.90, 1.08) (Table 2). In our review, we also identified articles that focused on specific system deficiencies. We found that GII was significantly associated with water outages in continuously operated distribution systems (RR = 3.26; 95% CI: 1.48, 7.19) as well as chronic outages in intermittent systems (OR = 1.61; 95% CI: 1.26, 2.07). In both types of systems, longer outages were associated with increased risk of GII compared to shorter outages. Other network deficiencies such as breach of physical pipe integrity and lack of chlorine residual were also associated with GII outcomes. Taken together, these findings suggest that (re)contamination of drinking water in distribution systems can present a health risk for consumers served by piped water networks.

It is important to note that our findings indicate evidence of publication bias, suggesting that studies with positive findings may have been preferentially published over those with null or inconclusive findings. It is therefore possible that our pooled effect estimates are higher than the

true health risk associated with distribution systems. Moreover, our review indicates that there are relatively few studies to date that focus on this critical topic, suggesting the need for further research.

Heterogeneity between study settings and designs

There was significant heterogeneity among study settings and water system characteristics. We used meta-analysis as a tool to explore the impact of these heterogeneities on study findings. Studies conducted in similar settings were combined, and pooled estimates were contrasted between such subgroups to highlight important differences (e.g., between continuous and intermittent systems or malfunctioning and non-malfunctioning networks). However, significant heterogeneity often remained even within subgroups.

One potential source of remaining heterogeneity, even after classifying studies as those conducted in malfunctioning vs. non-malfunctioning systems, is that myriad factors can influence the health risk associated with distribution systems, such as the number and size of leaks and cracks in pipes, the levels of fecal contamination present in the vicinity of pipelines, the magnitude and frequency of pressure loss events and levels of disinfectant residual in the affected pipe segments (LeChevallier et al. 2003). While broadly classifying networks as malfunctioning vs. non-malfunctioning based on system-wide performance data provides a basic tool for comparison, given the expected temporal and spatial variability in these factors, it is not surprising that our classifications did not fully capture the heterogeneity across studies. Moreover, most distribution systems have cracks and leaks as evidenced by water losses, which can be as high as 32% in US utilities (LeChevallier et al. 2003) and over 40% in developing countries (Lee and Schwab 2005), suggesting that no distribution system is truly non-malfunctioning. However, the presence of cracks and leaks alone is not sufficient for pathogen

intrusion, given that the network maintains adequate pressure and disinfectant residual (Besner et al. 2011). This suggests that our classification of networks with adequate levels of residual and no documented pressure loss during the study as “non-malfunctioning” is consistent with the principles of pathogen intrusion into pipes and that our findings are relevant to the contexts under which most systems operate. Nonetheless, collection of more fine-grained data on these system parameters could improve the interpretation of future studies.

Study designs also varied widely among articles included in our review. While the studies comparing tap versus POU-treated water consumption almost exclusively employed randomized designs, studies of specific distribution system characteristics used observational methods including cohort, cross-sectional and ecological designs. Observational studies varied in their attempts to control for confounding; some reported unadjusted estimates while others controlled for confounding. Factors that investigators controlled for (e.g., household income, hygiene practices, sanitation and sewerage facilities) were also not consistent across studies. The most common observational design was cross-sectional studies. One potential flaw of this design is the inability to establish temporality (Rothman et al. 2008). Ecological studies were also commonly used to study network characteristics at service area levels, and this design is vulnerable to the “ecological fallacy” where associations observed between aggregate exposures and outcomes may not reflect true causal relationships at the individual level (Rothman et al. 2008). Regardless, in our review we found that results were generally consistent (effect measures >1 associated with distribution system deficiencies), despite the differences in study designs.

Potential limitations of studies

Recall bias

In studies with self-reported outcomes (e.g., diarrhea symptoms), there is evidence from the literature that exposure status can influence symptom recall and consequently effect measures (Colford Jr et al. 2009; Hunter 2009; Schmidt and Cairncross 2009). Consistent with this evidence, the subset of non-blinded studies in our review showed a significant association between tap versus POU-treated water consumption and self-reported GII, yet there was no evidence of an association in blinded studies. We could not explore the role of lack of blinding separately from malfunctioning systems due to overlap between studies, and therefore cannot rule out recall bias. Studies in our review that focused on specific network deficiencies such as water outages were non-blinded by the nature of the exposures studied. One of these studies assessed the impact of participants' knowledge of their exposure status on the findings (Nygard et al. 2007). In this study, investigators selected participants who experienced an outage based on water utility data. They then asked participants whether they thought there was a main break or repair in the pipes supplying their homes; 75% of exposed participants replied "yes" compared to 25% of unexposed participants ($p < 0.001$), indicating awareness of exposure. However, stratified analyses among participants who believed they were exposed versus unexposed showed similar associations between water outage and GII, suggesting that any bias in reporting of outcomes due to lack of blinding had a negligible impact on their findings. Another study assessing the impact of cross-connections reported increased recall of GII symptoms during the period when there was media awareness about fecal contamination in the pipe (D'Argenio et al. 1995). The authors found higher rates of GII in both exposed and unexposed groups during this period compared to when the presence of contamination was not yet publicly known. However, the

exposed group with cross-connections had higher risk of GII than the unexposed group during both periods, again suggesting that the findings are robust to recall bias. Nonetheless, objective measures of waterborne illness, such as pathogen-specific antigen responses, could improve future reporting of non-blinded studies evaluating the impact of water distribution systems on the health of consumers. Negative control outcomes (i.e., outcomes that are not expected to be affected by tap water exposure) can be used to assess the magnitude of recall bias when measuring objective outcomes is not feasible (Lipsitch et al. 2010).

Water contamination prior to distribution system entry

In studies comparing tap versus POU-treated water, there is the possibility that water contamination prior to rather than within the distribution system is responsible for the increase in GII in tap water consumers. In the studies in our review, plant effluent was in compliance with regulations and no treatment failures were reported. However, regulatory standards are often based on indicator organisms for fecal contamination, whose ability to predict disease is controversial (Gundry et al. 2004). Only three studies performed additional tests for selected human enteric viruses and parasites in the finished plant water, and no such organisms were detected. For the remaining studies, one cannot exclude the possibility that the plant effluent may contain disinfection-resistant pathogens such as *Cryptosporidium*, whose absence cannot be confirmed by the absence of indicator organisms (Gadgil 1998). Short-term imperfections in plant performance, such as transient breakthrough of turbidity from filters, and low-level or sporadic breakthrough of pathogens have also been suggested as mechanisms for contamination that would not be detected by routine plant performance monitoring (Payment and Hunter 2001). One of the studies in our review did have an additional study arm consuming finished plant water that had been bottled before distribution system entry. GII in this group was similar to the group

consuming POU-treated water and significantly lower than the tap water group (Payment et al. 1997). While we cannot rule out the role of water contamination prior to distribution for the other studies in our review, this study was able to isolate the distribution system as the source of contamination. Similar methods could improve the interpretation of future studies.

Water contamination at user endpoints

One limitation of the studies investigating the effects of water outages is their failure to account for water handling and hygiene practices during the outages. In these studies, it is possible that the observed increase in illness may be mediated by altered practices in the household during the intermittencies in service, as opposed to pathogen intrusion into pipelines during pressure loss in the system. Such practices could include reverting to alternate sources of water that are of poor quality, secondary contamination of stored water in the household (Mintz et al. 1995) or poor hygiene due to reduced quantities of available water (Esrey et al. 1991). One of the studies in our review reported no deterioration in tap water quality following water outages and also found increases in skin and eye infections associated with outages, suggesting that an alternative water-washed pathway was the primary risk factor for the observed increase in GII symptoms (Huang et al. 2011). This would not change the general conclusion that service disruptions are associated with an increased risk of GII, but would have different policy implications with emphasis on preventing water outages as opposed to measures to minimize pathogen intrusion during an outage. However, another study in our review reported that the odds of GII were reduced when the pipe segment affected by the main break or repair work was flushed or re-chlorinated, suggesting that pathogen intrusion into pipelines during periods of pressure loss is at least partly responsible for increased illness (Nygard et al. 2007).

Dose-response relationships

Findings from several studies in our review suggested increasing GII with increases in volume of tap water consumed, duration of a water outage and residence time of water in the distribution system. Volume of contaminated tap water intake would be expected to predict consumers' ingested pathogen load. Two studies in our review classified the volume of water intake as a three-level categorical variable and detected a significant trend in GII incidence with respect to these categories (Payment et al. 1991, 1997) while Nygard et al. 2007 showed higher risk of GII in households consuming >1 vs. ≤ 1 glass of water per person per day. Importantly, a positive dose-response relation with water consumption was only reported in tap water consumers in malfunctioning systems; participants with POU-treated water (Payment et al. 1991, 1997) or those not exposed to water outages (Nygard et al. 2007) did not show evidence of increasing GII with increasing water consumption. Along similar lines, increasing duration of water outages would make pipes vulnerable to backflow and intrusion for longer periods. Three studies in our review showed increased GII associated with longer vs. shorter outages (Abu Amr and Yassin 2008; Nygard et al. 2007; Yassin et al. 2006). Finally, longer pipelines would have a larger number of cracks and leaks, increasing the number of potential portals for pathogen intrusion. One study in our review showed increasing GII per 10-meter increase in pipe length per person (Nygard et al. 2004) while another found zip codes with long hydraulic residence time in the distribution system at higher risk of GII than zip codes with intermediate residence time (Tinker et al. 2009). Analysis of data from Payment et al. 1991 showed increasing IDR for tap vs. POU-treated water consumption in zones more distant from the treatment plant (Payment et al. 1993). Volume of tap water consumption, duration of water outages and hydraulic residence time would

all be expected to increase opportunities for ingestion of water recontaminated in distribution pipes and elevate the risk of GII, which is consistent with the findings of this review.

Conclusions

Although it is well established that large disruptions in water distribution systems can cause outbreaks of waterborne illness (Craun and Calderon 2001; Craun et al. 2010; Lee and Schwab 2005), we believe this to be the first systematic review of the available published evidence of the impact of routine distribution system problems on low-level, background gastrointestinal illness. The evidence we present suggests that tap water consumption is associated with endemic GII in malfunctioning distribution networks. Specific system deficiencies such as loss of pipe integrity, water outages and inadequate residual are also associated with increased risk of GII. Although the available evidence does not allow us to rule out non-causal mechanisms for this association, the consistency of our findings justify further research on this critical topic.

Randomized controlled trials comparing tap water consumption to consumption of water treated at the point of use are a strong study design for characterizing health risk from overall distribution system deficiencies. Prospective cohort studies that use utility data to identify system failures and follow up with affected and unaffected tap water consumers are a suitable study design to investigate the health impact of specific distribution system problems that allows establishing temporality between exposures and outcomes. Future studies should, ideally, include blinding or objective outcomes to minimize recall bias, collect more detailed water system measurements relevant to the homes of participants to better characterize individual exposure to distribution system problems and measure microbiological water quality at key points between the water treatment plant and the point of consumption to differentiate contamination occurring in the distribution system from treatment plant failures or point-of-use contamination.

References

- Abu Amr SS, Yassin MM. 2008. Microbial contamination of the drinking water distribution system and its impact on human health in Khan Yunis Governorate, Gaza Strip: seven years of monitoring (2000-2006). *Public Health* 122:1275–1283; doi:10.1016/j.puhe.2008.02.009.
- Abu Mourad TA. 2004. Palestinian refugee conditions associated with intestinal parasites and diarrhoea: Nuseirat refugee camp as a case study. *Public Health* 118:131–142; doi:10.1016/j.puhe.2003.09.002.
- Besner MC, Broséus R, Lavoie J, Giovanni GD, Payment P, Prévost M. 2010. Pressure monitoring and characterization of external sources of contamination at the site of the Payment drinking water epidemiological studies. *Environ Sci Technol* 44:269–277; doi:10.1021/es901988y.
- Besner MC, Prévost M, Regli S. 2011. Assessing the public health risk of microbial intrusion events in distribution systems: Conceptual model, available data, and challenges. *Water Res* 45:961–979; doi:10.1016/j.watres.2010.10.035.
- Black RE, Morris SS, Bryce J. 2003. Where and why are 10 million children dying every year? *Lancet* 361:2226–2234; doi:10.1016/S0140-6736(03)13779-8.
- Cifuentes E, Suárez L, Solano M, Santos R. 2002. Diarrheal diseases in children from a water reclamation site in Mexico city. *Environ Health Perspect* 110:A619–A624.
- Colford JM, Roy S, Beach MJ, Hightower A, Shaw SE, Wade TJ. 2006. A review of household drinking water intervention trials and an approach to the estimation of endemic waterborne gastroenteritis in the United States. *J Water Health* 04:71–88; doi:10.2166/wh.2006.018.
- Colford Jr JM, Hilton JF, Wright CC, Arnold BF, Saha S, Wade TJ, et al. 2009. The Sonoma water evaluation trial: a randomized drinking water intervention trial to reduce gastrointestinal illness in older adults. *Am J Public Health* 99:1988–1995; doi:10.2105/AJPH.2008.153619.
- Colford Jr JM, Rees JR, Wade TJ, Khalakdina A, Hilton JF, Ergas IJ, et al. 2002. Participant blinding and gastrointestinal illness in a randomized, controlled trial of an in-home drinking water intervention. *Emerg Infect Dis* 8:29–36.
- Colford Jr JM, Saha SR, Wade TJ, Wright CC, Vu M, Charles S, et al. 2005. A pilot randomized, controlled trial of an in-home drinking water intervention among HIV+ persons. *J Water Health* 3:173–184.

- Colford Jr JM, Wade TJ, Sandhu SK, Wright CC, Lee S, Shaw S, et al. 2005. A randomized, controlled trial of in-home drinking water intervention to reduce gastrointestinal illness. *Am J Epidemiol* 161:472–482; doi:10.1093/aje/kwi067.
- Craun GF, Brunkard JM, Yoder JS, Roberts VA, Carpenter J, Wade T, et al. 2010. Causes of outbreaks associated with drinking water in the United States from 1971 to 2006. *Clin Microbiol Rev* 23:507–528; doi:10.1128/CMR.00077-09.
- Craun GF, Calderon RL. 2001. Waterborne disease outbreaks caused by distribution system deficiencies. *J Am Water Works Assoc* 93:64–75.
- D'Argenio P, Masi S De, Maestro A, Ortolani R, Pizzuti R, Russo M, et al. 1995. Rapid evaluation of the health impact of the pollution of naples' water system. *J Prev Med Hyg* 36:99–104.
- Egger M, Smith GD, Altman DG. 2001. *Systematic Reviews in Health Care. Meta-Analysis in Context*. London: BMJ Books.
- Egorov A, Ford T, Tereschenko A, Drizhd N, Segedevich I, Fourman V. 2002. Deterioration of drinking water quality in the distribution system and gastrointestinal morbidity in a Russian city. *Int J Environ Health Res* 12:221–233; doi:10.1080/09603/202/000000989.
- Ericsson CD. 1998. Traveler's diarrhea: Epidemiology, prevention, and self-treatment. *Infect Dis Clin North Am* 12:285–303; doi:10.1016/S0891-5520(05)70006-4.
- Esrey SA, Potash JB, Roberts L, Shiff C. 1991. Effects of improved water supply and sanitation on ascariasis, diarrhoea, dracunculiasis, hookworm infection, schistosomiasis, and trachoma. *Bull World Health Organ* 69:609–621.
- Fewtrell L, Kay D, Wyer M, O'Neill G. 1997. An investigation into the possible links between shigellosis and hepatitis A and public water supply disconnections. *Public Health* 111:179–181; doi:10.1016/S0033-3506(97)00579-9.
- Gadgil A. 1998. Drinking water in developing countries. *Annu Rev Energ Environ* 23:253–286; doi:10.1146/annurev.energy.23.1.253.
- Gerba CP, Rose JB, Haas CN. 1996. Sensitive populations: who is at the greatest risk? *Int J Food Microbiol* 30:113–123.
- Gundry S, Wright J, Conroy R. 2004. A systematic review of the health outcomes related to household water quality in developing countries. *J Water Health* 2:1–14.

- Hellard ME, Sinclair MI, Forbes AB, Fairley CK. 2001. A randomized, blinded, controlled trial investigating the gastrointestinal health effects of drinking water quality. *Environ Health Perspect* 109:773–778.
- Herikstad H, Yang S, Gilder TJ Van, Vugia D, Hadler J, Blake P, et al. 2002. A population-based estimate of the burden of diarrhoeal illness in the United States: FoodNet, 1996–7. *Epidemiol Infect* 129:9–17; doi:10.1017/S0950268801006628.
- Huang LY, Wang YC, Liu CM, Wu TN, Chou CH, Sung FC, et al. 2011. Water outage increases the risk of gastroenteritis and eyes and skin diseases. *BMC Public Health* 11:726; doi:10.1186/1471-2458-11-726.
- Hunter PR. 2009. Household water treatment in developing countries: comparing different intervention types using meta-regression. *Environ Sci Technol* 43:8991–8997; doi:10.1021/es9028217.
- Hunter PR, Chalmers RM, Hughes S, Syed Q. 2005. Self-reported diarrhea in a control group: a strong association with reporting of low-pressure events in tap water. *Clin Infect Dis* 40:e32–e34.
- IMF (International Monetary Fund). 2013. *World Economic Outlook*. Washington, DC: International Monetary Fund Publication Services. Available: <http://www.imf.org/external/pubs/ft/weo/2013/01/pdf/text.pdf> [accessed 14 June 2013].
- Lambertini E, Borchardt MA, Kieke BA, Spencer SK, Loge FJ. 2012. Risk of viral acute gastrointestinal illness from nondisinfected drinking water distribution systems. *Environ Sci Technol* 46:9299–9307; doi:10.1021/es3015925.
- LeChevallier MW, Gullick RW, Karim MR, Friedman M, Funk JE. 2003. The potential for health risks from intrusion of contaminants into the distribution system from pressure transients. *J Water Health* 1:3–14.
- LeChevallier MW, Karim MR, Aboytes R, Weihe J, Earnhardt B, Mohr J, et al. 2002. Water quality monitoring during the Davenport epidemiology study [Abstract]. In: Abstracts of the General Meeting of the American Society for Microbiology.
- Lee EJ, Schwab KJ. 2005. Deficiencies in drinking water distribution systems in developing countries. *J Water Health* 3:109–127.
- Lipsitch M, Tchetgen E, Cohen T. 2010. Negative controls: A tool for detecting confounding and bias in observational studies. *Epidemiol* 21:383–388; doi:10.1097/EDE.0b013e3181d61eeb.

- Lozano R, Naghavi M, Foreman K, Lim S, Shibuya K, Aboyans V, et al. 2012. Global and regional mortality from 235 causes of death for 20 age groups in 1990 and 2010: a systematic analysis for the Global Burden of Disease Study 2010. *The Lancet* 380:2095–2128; doi:10.1016/S0140-6736(12)61728-0.
- McInnis D. 2004. A relative-risk framework for evaluating transient pathogen intrusion in distribution systems. *Urban Water Journal* 1:113–127; doi:10.1080/15730620412331290010.
- Messner M, Shaw S, Regli S, Rotert K, Blank V, Soller J. 2006. An approach for developing a national estimate of waterborne disease due to drinking water and a national estimate model application. *J Water Health* 04:201–240; doi:10.2166/wh.2006.024.
- Mintz ED, Reiff FM, Tauxe RV. 1995. Safe Water Treatment and Storage in the Home: A Practical New Strategy to Prevent Waterborne Disease. *J Amer Med Assoc* 273:948–953; doi:10.1001/jama.1995.03520360062040.
- Mohanty JC, Ford TE, Harrington JJ, Lakshmi pathy V. 2002. A cross-sectional study of enteric disease risks associated with water quality and sanitation in Hyderabad City. *J Water Supply Res T* 51:239–251.
- NRC (National Research Council), 2006. *Drinking Water Distribution Systems: Assessing and Reducing Risks*. Washington, DC:National Academies Press. Available: http://www.nap.edu/catalog.php?record_id=11728 [accessed 14 June 2013].
- Nygaard K, Andersson Y, RøTtingen JA, Svensson å., Lindbäck J, Kistemann T, et al. 2004. Association between environmental risk factors and campylobacter infections in Sweden. *Epidemiol Infect* 132:317–325; doi:10.1017/S0950268803001900.
- Nygaard K, Wahl E, Krogh T, Tveit OA, Bøhleng E, Tverdal A, et al. 2007. Breaks and maintenance work in the water distribution systems and gastrointestinal illness: a cohort study. *Int J Epidemiol* 36:873–880; doi:10.1093/ije/dym029.
- Özkan S, Tüzün H, Görer N, Ceyhan M, Aycan S, Albayrak S, et al. 2007. Water usage habits and the incidence of diarrhea in rural Ankara, Turkey. *Trans R Soc Trop Med Hyg* 101:1131–1135; doi:10.1016/j.trstmh.2007.05.011.
- Payment P. 1999. Poor efficacy of residual chlorine disinfectant in drinking water to inactivate waterborne pathogens in distribution systems. *Can J Microbiol* 45:709–715; doi:10.1139/cjm-45-8-709.

- Payment P, Franco E, Siemiatycki J. 1993. Absence of relationship between health effects due to tap water consumption and drinking water quality parameters. *Water Sci Technol* 27:137–143.
- Payment P, Hunter PR. 2001. Endemic and epidemic infectious intestinal disease and its relationship to drinking water. In: *Water Quality: Guidelines, Standard and Health* (Adair L, Bartram J, eds). London: IWA Publishing WHO, 61–88.
- Payment P, Richardson L, Siemiatycki J, Dewar R, Edwardes M, Franco E. 1991. A randomized trial to evaluate the risk of gastrointestinal disease due to consumption of drinking water meeting current microbiological standards. *Am J Public Health* 81:703–708.
- Payment P, Siemiatycki J, Richardson L, Renaud G, Franco E, Prevost M. 1997. A prospective epidemiological study of gastrointestinal health effects due to the consumption of drinking water. *Int J Environ Health Res* 7:5–31.
- Reynolds KA, Mena KD, Gerba CP. 2008. Risk of waterborne illness via drinking water in the United States. *Rev Environ Contam Toxicol* 192:117–158.
- Rothman KJ, Greenland S, Lash TL. 2008. *Modern Epidemiology*. 3rd ed. Philadelphia: Lippincott Williams & Wilkins.
- Roy SL, Beach MJ, Scallan E. 2006. The rate of acute gastrointestinal illness in developed countries. *J Water Health* 04:31–69; doi:10.2166/wh.2006.017.
- Schmidt WP, Cairncross S. 2009. Household water treatment in poor populations: is there enough evidence for scaling up now? *Environ Sci Technol* 43:986–992; doi:10.1021/es802232w.
- Semenza JC, Roberts L, Henderson A, Bogan J, Rubin CH. 1998. Water distribution system and diarrheal disease transmission: a case study in Uzbekistan. *Am J Trop Med Hyg* 59:941–946.
- Soller JA. 2006. Use of microbial risk assessment to inform the national estimate of acute gastrointestinal illness attributable to microbes in drinking water. *J Water Health* 04:165; doi:10.2166/wh.2006.022.
- Steiner MD, Thielman MD, Guerrant MD. 1997. Protozoal agents: what are the dangers for the public water supply? *Annu Rev Med* 48:329–340.

- Teunis PFM, Xu M, Fleming KK, Yang J, Moe CL, LeChevallier MW. 2010. Enteric virus infection risk from intrusion of sewage into a drinking water distribution network. *Environ Sci Technol* 44:8561–8566; doi:10.1021/es101266k.
- Tinker SC, Moe CL, Klein M, Flanders WD, Uber J, Amirtharajah A, et al. 2009. Drinking water residence time in distribution networks and emergency department visits for gastrointestinal illness in Metro Atlanta, Georgia. *J Water Health* 07:332–343; doi:10.2166/wh.2009.022.
- USEPA (United States Environmental Protection Agency). 2011. Aging Water Infrastructure Research: Science and Engineering for a Sustainable Future. Publication No. EPA/600/F-11/010. Available: <http://nepis.epa.gov/Adobe/PDF/P100EQ6Q.pdf> [accessed 14 June 2013].
- WHO (World Health Organization). 2011. Guidelines for Drinking-Water Quality, Fourth Edition. Geneva: World Health Organization. Available: http://www.who.int/water_sanitation_health/publications/2011/dwq_guidelines/en/ [accessed 14 June 2013].
- Yassin MM, Amr SSA, Al-Najar HM. 2006. Assessment of microbiological water quality and its relation to human health in Gaza Governorate, Gaza Strip. *Public Health* 120:1177–1187; doi:10.1016/j.puhe.2006.07.026.

Table 1. Study characteristics in studies of tap water vs. water treated at point of use.

Study	Location	Source Water	Treatment Plant	Distribution System	Design	Comparison Exposure	Effect Estimate (95% CI)
Payment et al. 1991	Canada	River receiving sewage; coliforms and viruses detected	Conventional treatment with ozonation and chlorination; no coliforms or viruses in effluent	Negative pressures; inadequate residual	CRT, non-blinded	RO-treated water	IDR = 1.36 (1.10, 1.69) ^a
Payment et al. 1997	Canada	Same river as 1991; coliforms, parasites and viruses detected	Conventional treatment with ozonation and chlorination; no coliforms, parasites or viruses in effluent	Same system as 1991; no fecal coliforms; coliforms detected in 0.6% of samples	CRT, non-blinded	Ozonated bottles of RO-treated plant water or spring water	IDR = 1.14 (0.91, 1.42) ^a
Semenza et al. 1998	Uzbekistan	Not reported	Two-stage chlorination	Pressure loss events; inadequate residual	Cohort ^b , non-blinded	Chlorinated water	IDR = 2.61 (1.71, 4.00) ^a
Hellard et al. 2001	Australia	Protected forest catchments; fecal coliforms detected	Chlorination; no coliforms in effluent	Inadequate residual; no fecal coliforms; coliforms detected in 19% of samples	CRT, blinded	Microfiltration + UV	IDR = 1.00 (0.86, 1.15)
Colford et al. 2002	USA	River receiving agriculture and industry run-off; pathogens detected	Conventional treatment with chloramination; effluent in compliance with regulations	Not reported	CRT, blinded	Microfiltration + UV	IDR = 1.32 (0.75, 2.33)
Colford et al. 2005	USA	River receiving sewage; parasites and viruses detected	Conventional treatment with chlorination; no coliforms, parasites, viruses in effluent	No negative pressures; adequate residual; no coliforms	CRT, blinded	Microfiltration + UV	IDR = 0.96 (0.85, 1.08)

CRT: cluster-randomized trial; RO: reverse osmosis; UV: ultraviolet, IDR: incidence density ratio.

^aCalculated from data reported in study. ^bObservational arm within cluster-randomized trial.

Table 2. Meta-analysis of studies of tap water vs. water treated at point of use.

Subgroup	Number of Studies	IDR (95% CI)	Heterogeneity χ^2 (p-value)^a
Study Type/Location			
CRT/Developed Country	5	1.09 (0.95, 1.25)	9.48 (0.050)
Cohort/Developing Country	1	2.61 (1.71, 4.00)	N/A
Blinding			
Non-Blinded	3	1.52 (1.05, 2.20)	11.40 (0.003)
Blinded	3	0.98 (0.90, 1.08)	1.25 (0.534)
Distribution System			
Malfunctioning System	4	1.34 (1.00, 1.79)	20.28 (< 0.0005)
Non-Malfunctioning System	1	0.96 (0.85, 1.08)	N/A
No Data on System	1	1.32 (0.75, 2.33)	N/A

IDR: incidence density ratio; CRT: cluster-randomized trial; N/A: Not applicable, only one study in subgroup.

^a χ^2 Statistic with a p-value less than 0.20 defined as evidence of heterogeneity.

Table 3. Study characteristics in studies of physical pipe integrity.^a

Study	Location	Source Water	Treatment Plant	Distribution System	Design	Exposure	Comparison Exposure	Outcome Assessment	Effect Estimate (95% CI)
D'Argenio et al. 1995	Italy	Not reported	Not reported	Some chlorine residual; total coliforms, fecal coliforms and fecal streptococci detected in affected pipe segment	Cohort	Pipeline with fecal contamination from cross-connections	Pipeline with no fecal contamination	Self-report	RR = 2.67 (1.16, 6.11) ^b
Mohanty et al. 2002	India	Surface water	Conventional treatment with chlorination	Intermittently operated; inadequate residual; total and fecal coliforms detected	Ecological	Unit increase in % of cast iron pipes in service zone	--	Self-report	Regression Coefficient -0.42 (p = 0.10)
Yassin et al. 2006	Palestine	Groundwater	Chlorination	Intermittently operated; inadequate residual; fecal contamination detected more often than at the source	Cross-sectional	Network >1 yr old	Network ≤ 1 yr old	Self-report	RR = 1.51 (0.80, 2.83) ^b
Abu Amr et al. 2008	Palestine	Groundwater	Chlorination	Intermittently operated; inadequate residual; fecal contamination detected more often than at the source	Cross-sectional	Network >1 yr old	Network ≤ 1 yr old	Self-report	RR = 1.03 (0.68, 1.56) ^b
Nygard et al. 2004	Sweden	Surface and groundwater	Chlorination (for surface water only)	Continuously operated; low-level residual	Ecological	10 m increase in pipe length per person in municipality	--	Surveillance records	IDR = 1.12 (1.08, 1.16)
Tinker et al. 2009	USA	Not reported	Not reported	Continuously operated; adequate residual	Ecological	Zip code with long hydraulic residence time	Zip code with intermediate hydraulic residence time	Emergency dept records	OR = 1.06 (1.04, 1.08) ^c

RR: relative risk; IDR: incidence density ratio; OR: odds ratio

^aResults not pooled. ^bCalculated from data reported in the study. ^cPooled from estimates for two utilities reported in the study.

Table 4. Study characteristics in studies of hydraulic pipe integrity.^a

Study	Location	Source Water	Treatment Plant	Distribution System	Design	Exposure	Comparison Exposure	Outcome Assessment	Effect Estimate (95% CI)
Continuous Systems									
Fewtrell et al. 1997	UK	Not reported	Not reported	Not reported	Ecological	Number of water outages in a zip code area	--	Surveillance records	Correlation coefficient Shigella 0.42 (p = 0.07) ^{a,b} Hep A 0.67 (p = 0.001) ^{a,b}
Hunter et al. 2005	UK	Not reported	Effluent in compliance with regulations	Not reported	Cross-sectional ^c	Water outage	No water outage	Self-report	OR = 12.50 (3.49, 44.71)
Nygaard et al. 2007	Norway	Not reported	Not reported	Not reported	Cohort	Water outage	No water outage	Self-report	OR = 2.00 (1.30, 3.20)
Nygaard et al. 2007	Norway	Not reported	Not reported	Not reported	Cross-sectional ^d	Outage >6 hrs long	Outage ≤ 6 hrs long	Self-report	OR = 1.90 (1.00, 3.40) ^b
Ozkan et al. 2007	Turkey	Not reported	Not reported	Not reported	Cross-sectional	Water outage >12 hrs long	No water outage >12 hrs long ^e	Self-report	OR = 10.28 (2.95, 35.48)
Huang et al. 2011	Taiwan	Not reported	Not reported	Not reported	Ecological	Days with water outage ^f	10 days with normal water supply before water outage	Hospital records	IDR = 1.31 (1.26, 1.37)
Intermittent Systems									
Cifuentes et al. 2002	Mexico	Groundwater	Chlorination	Not reported	Cross-sectional	Intermittent supply	Full-day supply	Self-report	OR = 2.00 (1.16, 3.70)
Abu Mourad 2004	Palestine	Groundwater	Not reported	Not reported	Cross-sectional	Intermittent supply	Full-day supply	Self-report	OR = 1.53 (1.15, 2.03) ^g
Yassin et al. 2006	Palestine	Groundwater	Chlorination	Inadequate residual	Cross-sectional	Intermittency >1 day long	Intermittency 1-day long	Self-report	RR = 1.33 (0.92, 1.91) ^g
Abu Amr et al. 2008	Palestine	Groundwater	Chlorination	Inadequate residual	Cross-sectional	Intermittency >1 day long	Intermittency 1-day long	Self-report	RR = 1.49 (1.06, 2.09) ^g

OR: odds ratio; IDR: incidence density ratio; RR: relative risk

^aResults from 1991; no summary result reported by authors for all years in study; authors found no evidence of a causative temporal link at individual level. ^bNot included in pooled analyses. ^cCross-sectional analysis within control group of case-control study. ^dCross-sectional analysis within exposed group of same cohort study. ^eAuthors specified water outages longer than 12 hours as a binary exposure variable; we have assumed that the comparison exposure includes outages ≤12 hours as well as no outages. ^fEffect estimate was similar when the 10-day period following the outage was used as the exposure. ^gCalculated from data reported in study.

Table 5. Study characteristics in studies of water quality integrity.^a

Study	Design	Exposure	Comparison Exposure	Outcome Assessment	Effect Estimate (95% CI)
Semenza et al. 1998	Cross-sectional ^b	Non-detect chlorine in household water sample from piped supply	Detectable chlorine in household water sample from piped supply	Self-report	IDR = 1.60 (0.70, 3.70)
Egorov et al. 2002	Cross-sectional	Interquartile range (0.22 mg/L) decrease in chlorine	--	Self-report	IDR = 1.42 (1.05, 1.91)
Mohanty et al. 2002	Ecological	Unit increase in % of distribution system samples with non-detect chlorine in service zone	--	Self-report	Regression Coefficient 0.46 (p = 0.64)

IDR: incidence density ratio

^aResults not pooled. ^bCross-sectional analysis within exposed group of cluster-randomized trial.

FIGURE LEGENDS

Figure 1. Categorization of Studies for Meta-Analysis

Figure 2. Flowchart for Inclusion and Exclusion of Articles

Figure 3. Random Effects Meta-Analysis of GII and Tap Water vs. Water Treated at Point of Use among Studies in Malfunctioning Systems

(Selected for inclusion as the measured exposure was consumption of centrally distributed tap water, participants received their tap water from centralized water treatment systems and there was documented malfunction in the distribution system.)

Figure 4. Random Effects Meta-Analysis of GII and Water Outage in Continuous Systems

(Selected for inclusions as the measured exposure was consumption of centrally distributed tap water and participants experienced a breach of hydraulic pipe integrity through water outages in otherwise continuously operating distribution systems.)

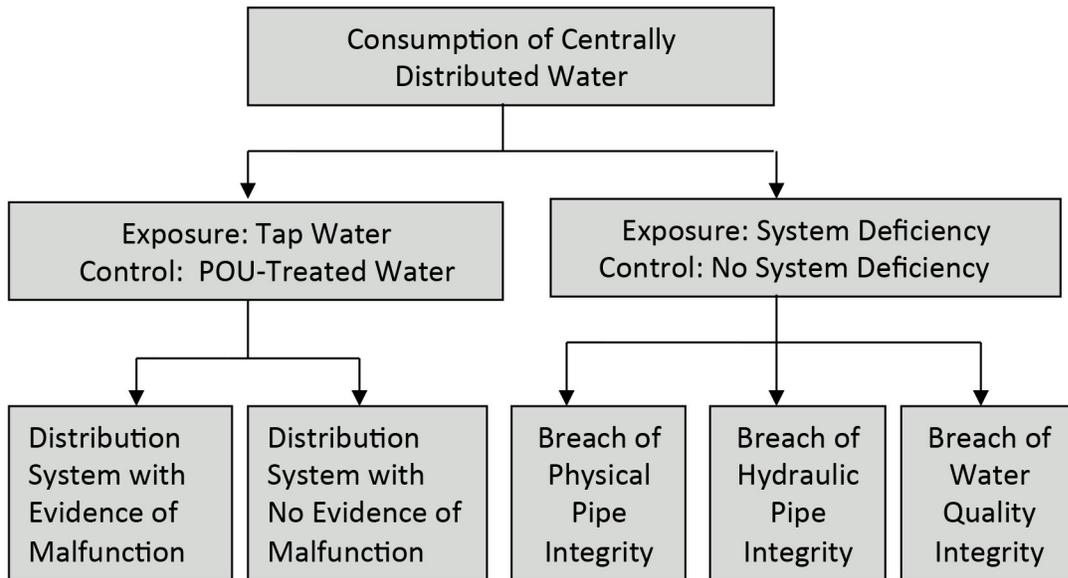


FIGURE 1

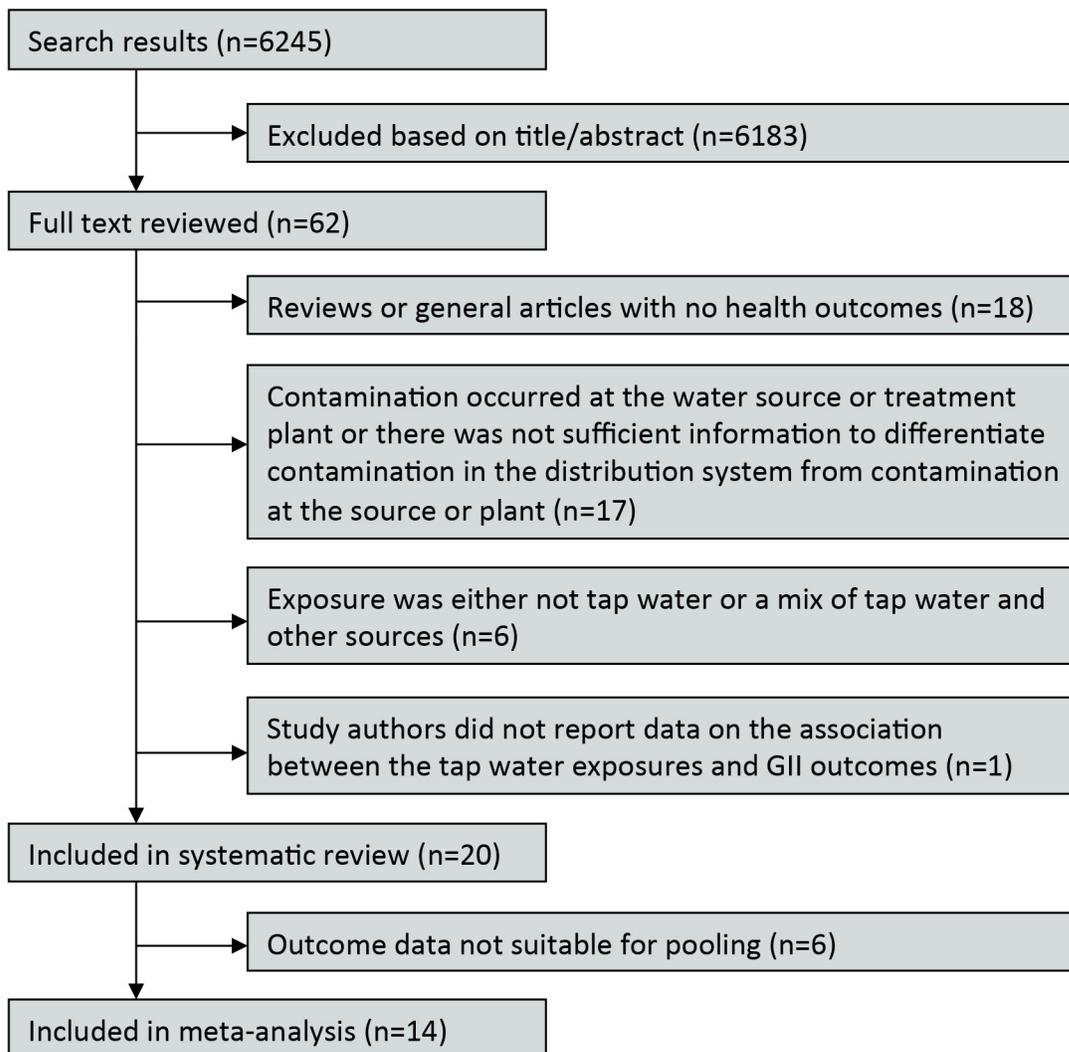


FIGURE 2

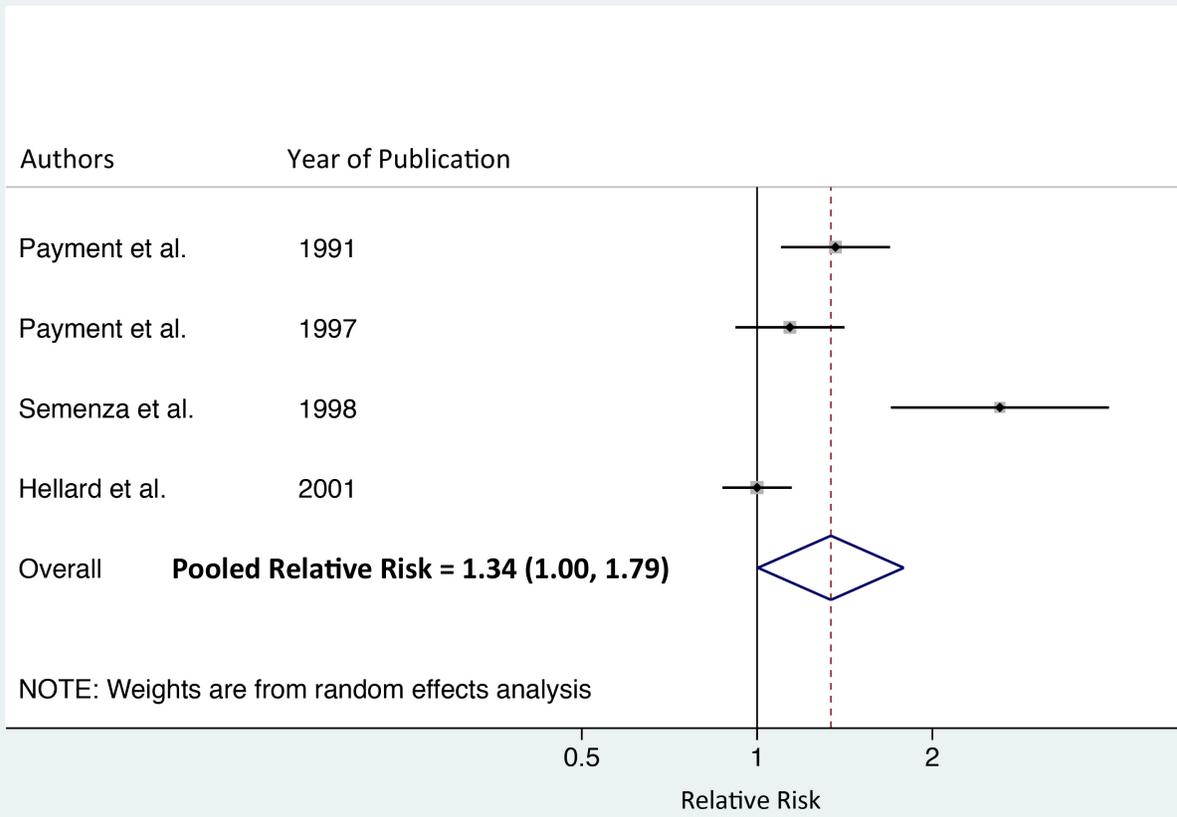


FIGURE 3

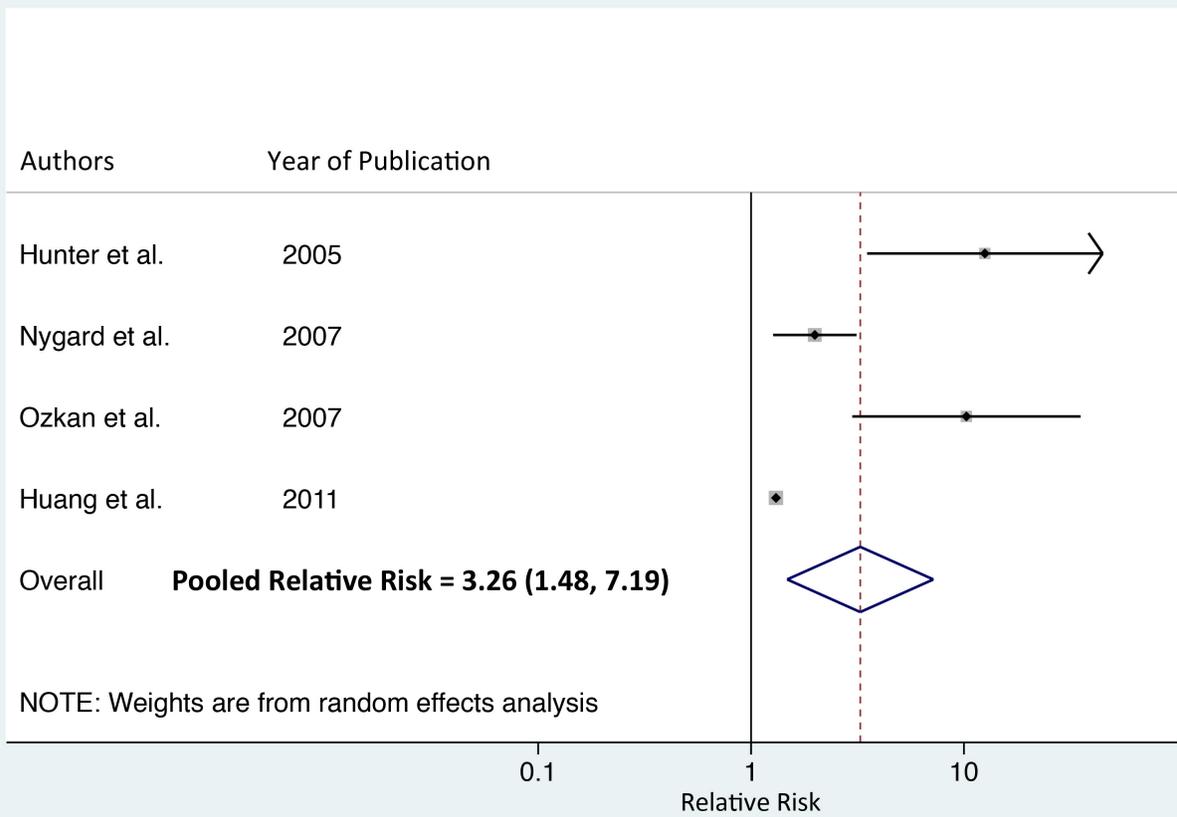


FIGURE 4